

THIS DETAIL IS FOR 3/4" AND 1" DOMESTIC WATER SERVICES WHERE A CONTINUOUS ROLL OF COPPER FROM CURB BOX TO INSIDE WALL OF HOUSE OR STRUCTURE COULD NOT BE INSTALLED. APPROPRIATE BACKFLOW PREVENTOR TO BE APPROVED BY STWA PRIOR TO INSTALLATION.

PLEASE COMPLETE & RETURN TO SUMMIT
TOWNSHIP WATER AUTHORITY:

1230 TOWNHALL ROAD WEST
SUITE 200
ERIE, PA 16509
PHONE: (814) 864-2323

RESIDENTIAL / NON-RESIDENTIAL (CIRCLE)
NAME: _____
SERVICE ADDRESS: _____

PLUMBER NAME: _____
DATE SUBMITTED: _____

APPROVAL STAMP


APPROVED BY: _____

DATE APPROVED: _____

APPROVAL RETURNED: _____

NOTES:

1. ANY MODIFICATION MUST BE APPROVED BY THE STWA IN ADVANCE.
1. ALL PRECAUTIONS SHALL BE TAKEN FOR PROPER DRAINAGE.
2. SCHEDULE AN INSPECTION WITH STWA AT LEAST 24 HOURS PRIOR TO INSTALLING AND BACKFILLING SERVICE LINE AND METER PIT.
3. THERMAL EXPANSION SHALL BE ADDRESSED BY CUSTOMER'S PLUMBER. CHECK LOCAL PLUMBING CODES FOR REQUIREMENTS.
4. ALL STWA SPECIFICATIONS MUST BE MET BEFORE WATER SERVICE IS INITIATED.
5. ALL PIPES, FITTINGS, AND FIXTURES IN CONTACT WITH POTABLE WATER SHALL BE LEAD FREE PER THE REDUCTION OF LEAD IN DRINKING WATER ACT AND NSF/ANSI STANDARD 61 (NSF-61). LEAD FREE IS DEFINED AS CONTAINING NOT MORE THAN A WEIGHTED AVERAGE OF 0.25 PERCENT LEAD WHEN USED WITH RESPECT TO THE WETTED SURFACES OF PIPES, PIPE FITTINGS, PLUMBING FITTINGS, AND FIXTURES.
6. ALL MATERIALS FURNISHED AND INSTALLED MUST COMPLY WITH THE PENNSYLVANIA STEEL PRODUCTS PROCUREMENT ACT.

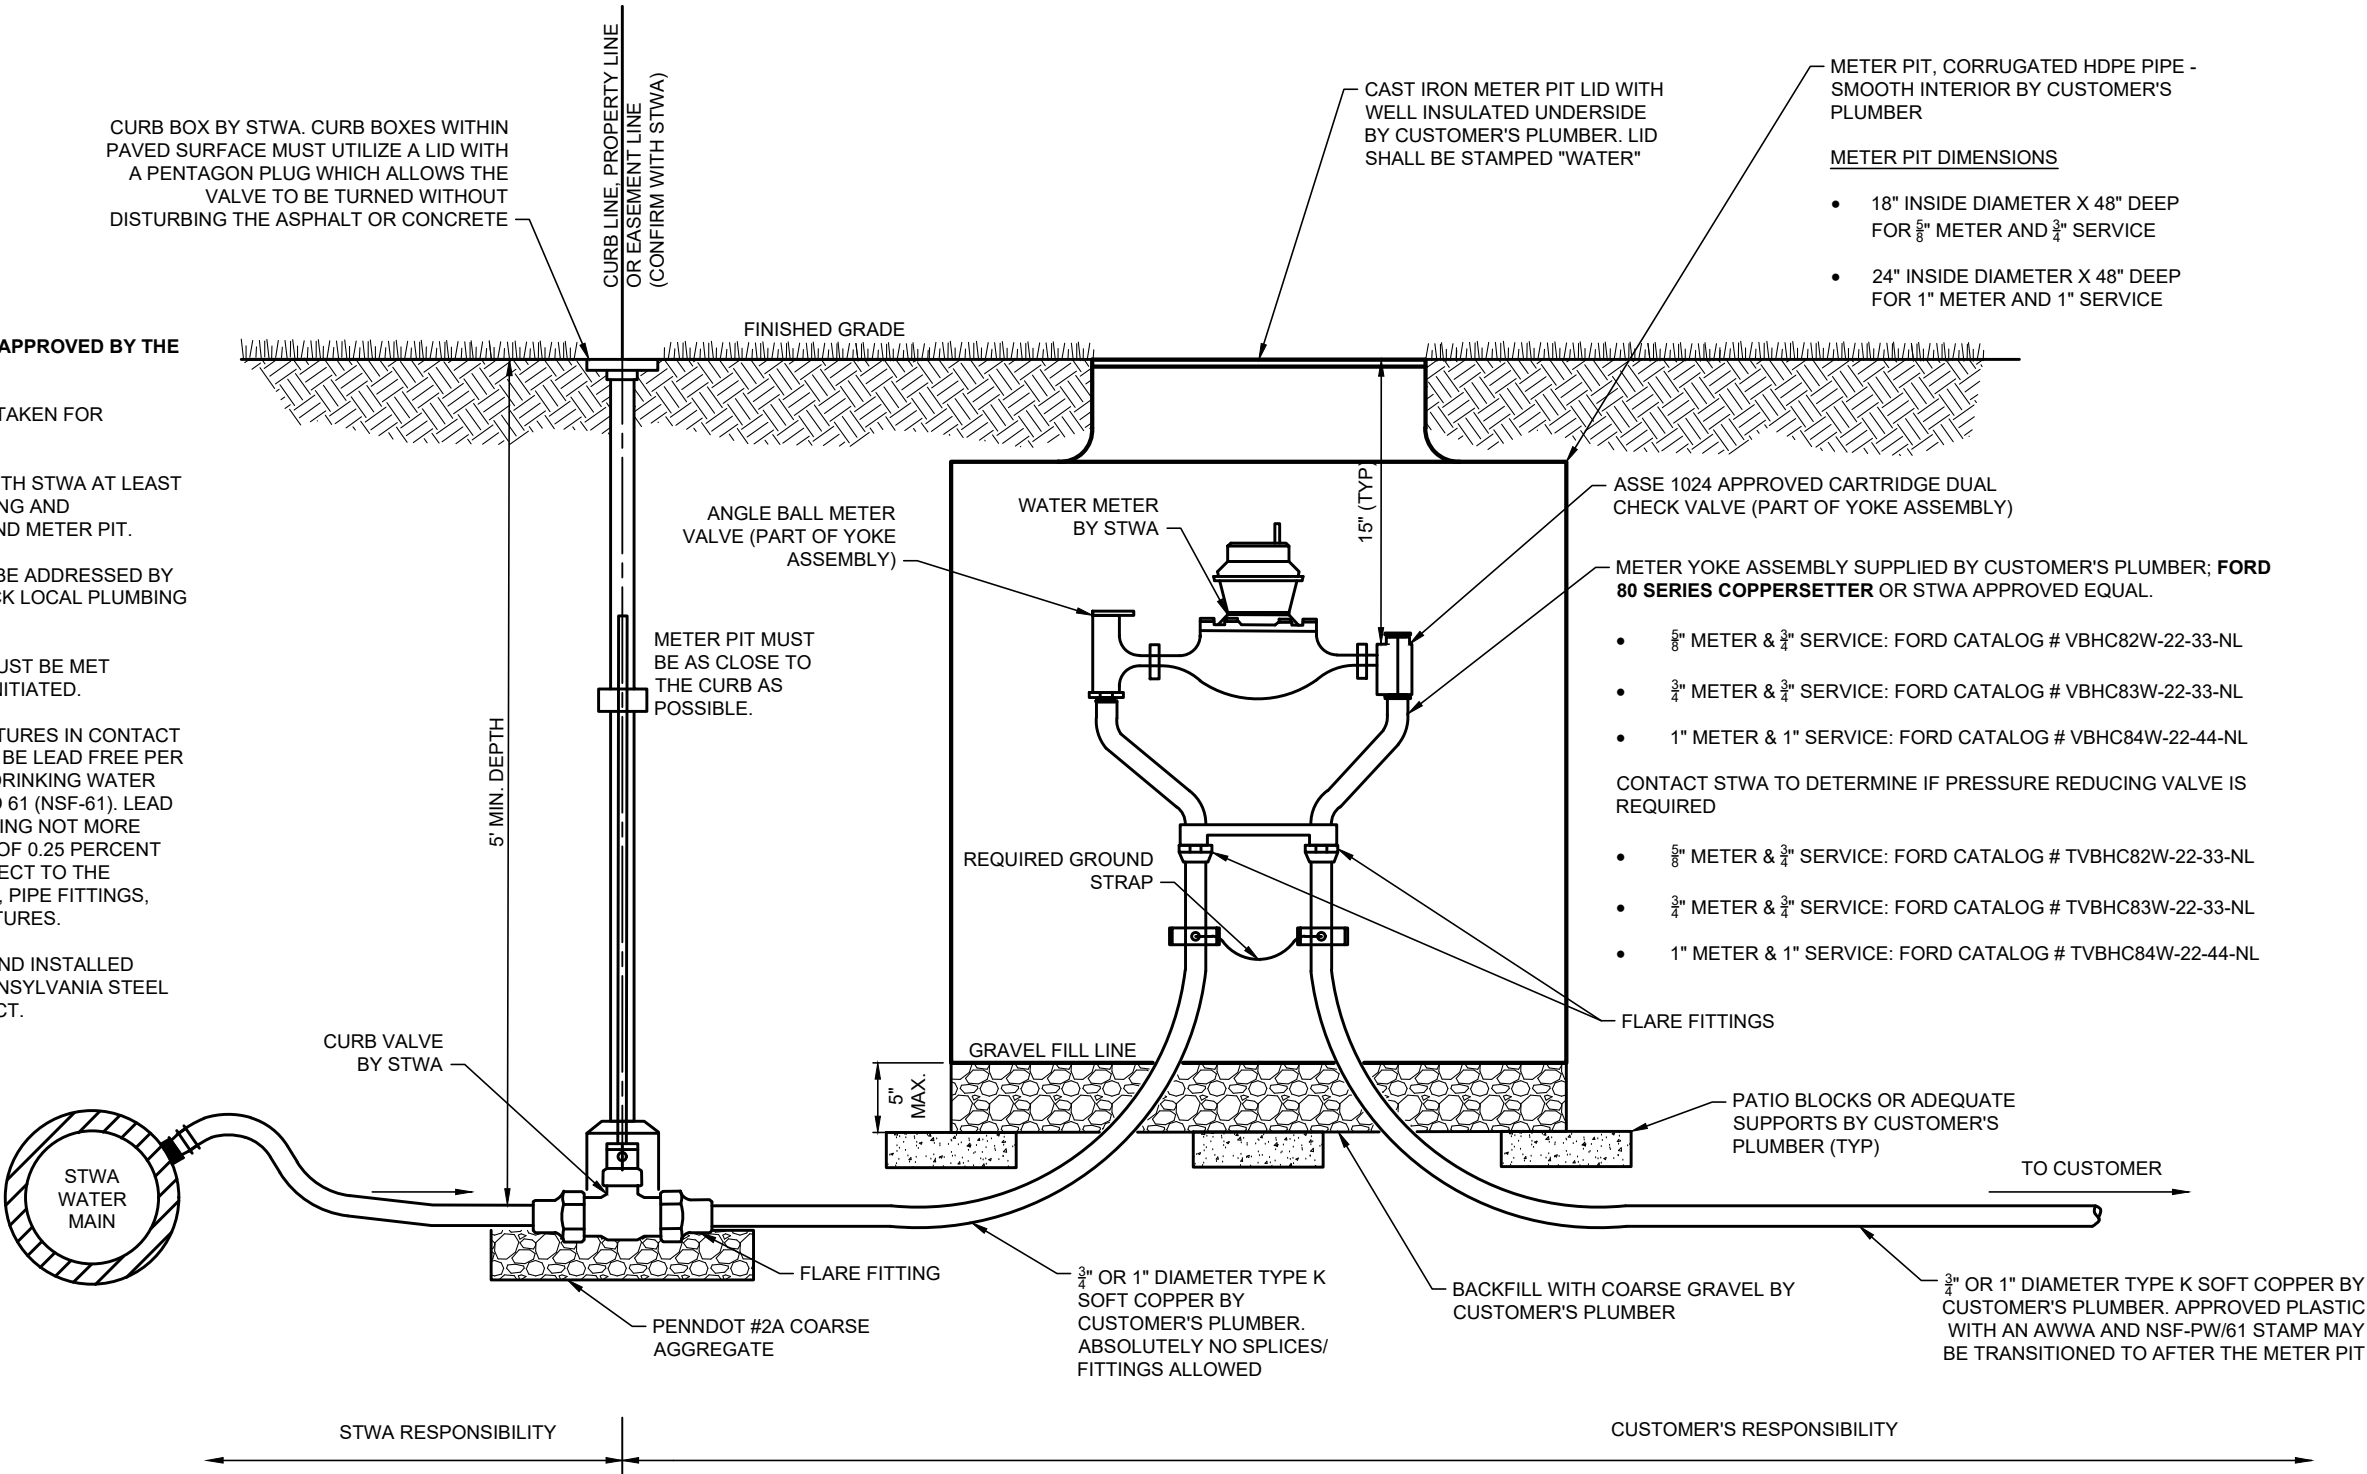

C:\USER\LEVELYN\DRIVE - VERDANTAS\PROJECTS\STWA\VERDANTAS\STWA_SD-04_DOMESTIC_WL_W\METER PIT-VERDANTAS.DWG - SD-04 - 8/19/2025 1:18:51 PM - LEVELYN SILER



**SUMMIT TOWNSHIP WATER
AUTHORITY**

1230 TOWNHALL ROAD WEST
SUITE 200
ERIE, PA 16509

DOMESTIC SERVICE (3/4" & 1") WITH METER PIT

verdantas

1625 LOWELL AVENUE
ERIE, PA 16505
(814) 833-3900

SCALE: NOT TO SCALE

ISSUE DATE: 08/2025

DRAWN BY: JEC

APPROVED BY: JZ

PROJECT NO.	
SHEET NAME	
SD-004	
SHEET	OF
1	1